


NFPA 1901-1906 REQUIREMENTS:

Product Description

Product Description	Qty.	POK part #
1. Strainers for Suction Hose if provided	1	8959, 8960, 8963
2. Nozzles 200 GPM Capable	1	TORNADOMATIC™
3. Nozzle 95 Capable	2	TURBOKADOR™
4. Playpipe with Shutoff and Stacked tips 1"X 1 1/8" X 1 1/4"	1	9988 + 8911
5. Gated Siamese for 4" – 6" Intakes	1	8151G, 2233G
6. Combination Spanner Wrenches with Bracket	4	10
7. Wrenches for Hydrant	2	22
8. Adapters, Double Female	2	1824
9. Adapters, Double Male	2	1821

Reference: National Fire Protection Association (NFPA).

Additional POK Equipment to Enhance your Pumper Fire Apparatus

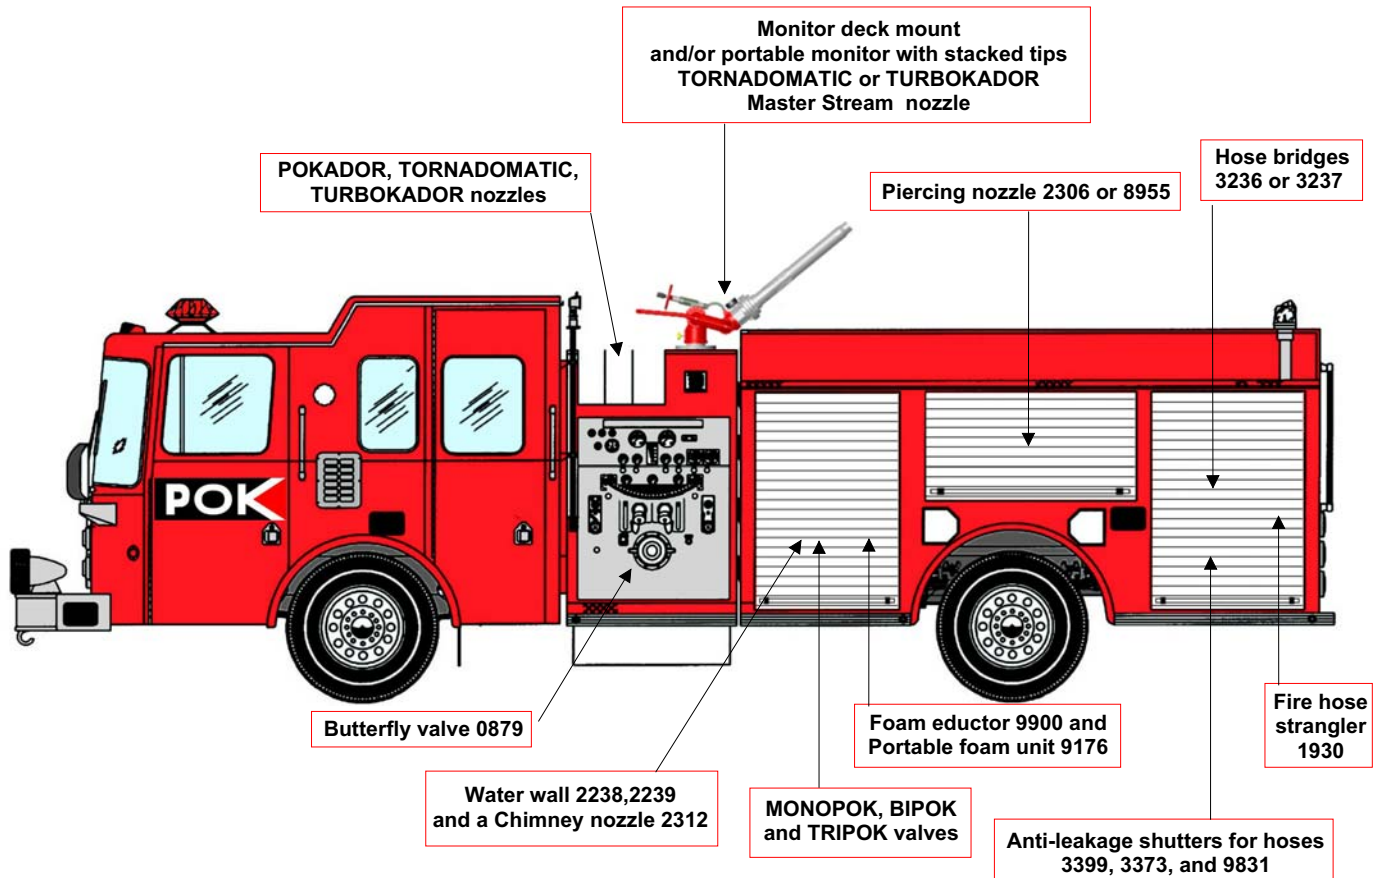

* Apparatus picture courtesy of W.S.Darley & Co.